


M3-16 TYPICAL

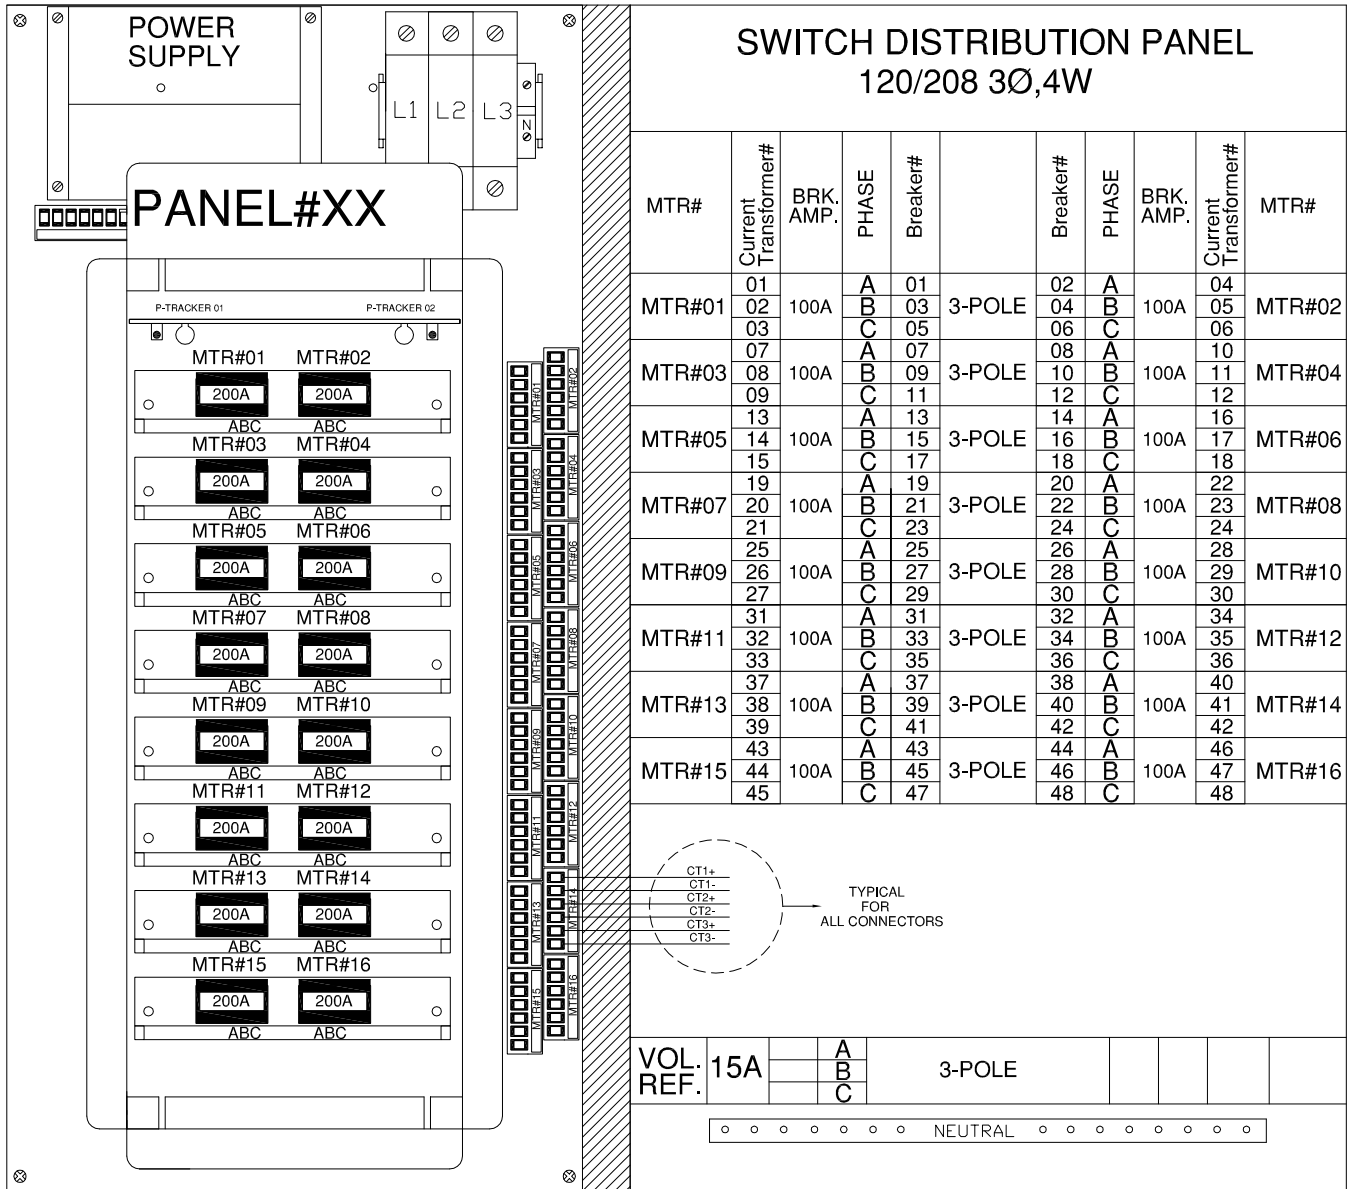

WARNING: METERING PANEL HAS BEEN PHASED ACCORDINGLY. DO NOT CHANGE ASSIGNED DISTRIBUTION.

SDP AND EMP DESIGNATION

SUITE NO.	MTR NO.	SUITE NO.	MTR NO.
IS METERED BY ▶	MTR#01	IS METERED BY ▶	MTR#02
IS METERED BY ▶	MTR#03	IS METERED BY ▶	MTR#04
IS METERED BY ▶	MTR#05	IS METERED BY ▶	MTR#06
IS METERED BY ▶	MTR#07	IS METERED BY ▶	MTR#08
IS METERED BY ▶	MTR#09	IS METERED BY ▶	MTR#10
IS METERED BY ▶	MTR#11	IS METERED BY ▶	MTR#12
IS METERED BY ▶	MTR#13	IS METERED BY ▶	MTR#14
IS METERED BY ▶	MTR#15	IS METERED BY ▶	MTR#16

N.B.: PLEASE COMPLETE THE SHOP DRAWING WITH THE APPROPRIATE SUITE IDENTIFICATION.
SDP : Switch Distribution Panel EMP: Electronic Metering Panel