


M3-16 TYPICAL

TRANSFORMER

POWER SUPPLY

SWITCH DISTRIBUTION PANEL
277/480V 3Ø,4W

PANEL#XX

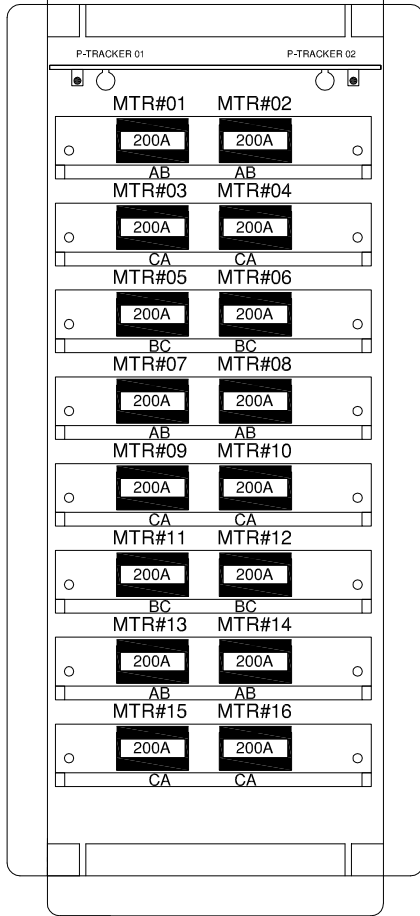

MTR#	Current Transformer#	BRK. AMP.	PHASE	Breaker#	Breaker#	PHASE	BRK. AMP.	Current Transformer#	MTR#
MTR#01	01	100A	A	01	2-POLE	A	100A	03	MTR#02
	02		B	03		B		04	
MTR#03	05	100A	C	05	2-POLE	C	100A	07	MTR#04
	06		A	07		A		08	
MTR#05	09	100A	B	09	2-POLE	B	100A	11	MTR#06
	10		C	11		C		12	
MTR#07	13	100A	A	13	2-POLE	A	100A	15	MTR#08
	14		B	15		B		16	
MTR#09	17	100A	C	17	2-POLE	C	100A	19	MTR#10
	18		A	19		A		20	
MTR#11	21	100A	B	21	2-POLE	B	100A	23	MTR#12
	22		C	23		C		24	
MTR#13	25	100A	A	25	2-POLE	A	100A	27	MTR#14
	26		B	27		B		28	
MTR#15	29	100A	C	29	2-POLE	C	100A	31	MTR#16
	30		A	31		A		32	

VOL. REF.	15A	A	B	C	3-POLE				
<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> NEUTRAL <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>									

WARNING: MTRING PANEL HAS BEEN PHASED ACCORDINGLY. DO NOT CHANGE ASSIGNED DISTRIBUTION.

SDP AND EMP DESIGNATION

SUITE NO.	MTR NO.	SUITE NO.	MTR NO.
IS METERED BY →	MTR#01	IS METERED BY →	MTR#02
IS METERED BY →	MTR#03	IS METERED BY →	MTR#04
IS METERED BY →	MTR#05	IS METERED BY →	MTR#06
IS METERED BY →	MTR#07	IS METERED BY →	MTR#08
IS METERED BY →	MTR#09	IS METERED BY →	MTR#10
IS METERED BY →	MTR#11	IS METERED BY →	MTR#12
IS METERED BY →	MTR#13	IS METERED BY →	MTR#14
IS METERED BY →	MTR#15	IS METERED BY →	MTR#16

N.B.: PLEASE COMPLETE THE SHOP DRAWING WITH THE APPROPRIATE SUITE IDENTIFICATION.
SDP : Switch Distribution Panel EMP: Electronic MTRing Panel