


M3-24 WITH 10AMP INPUT(TYPICAL)

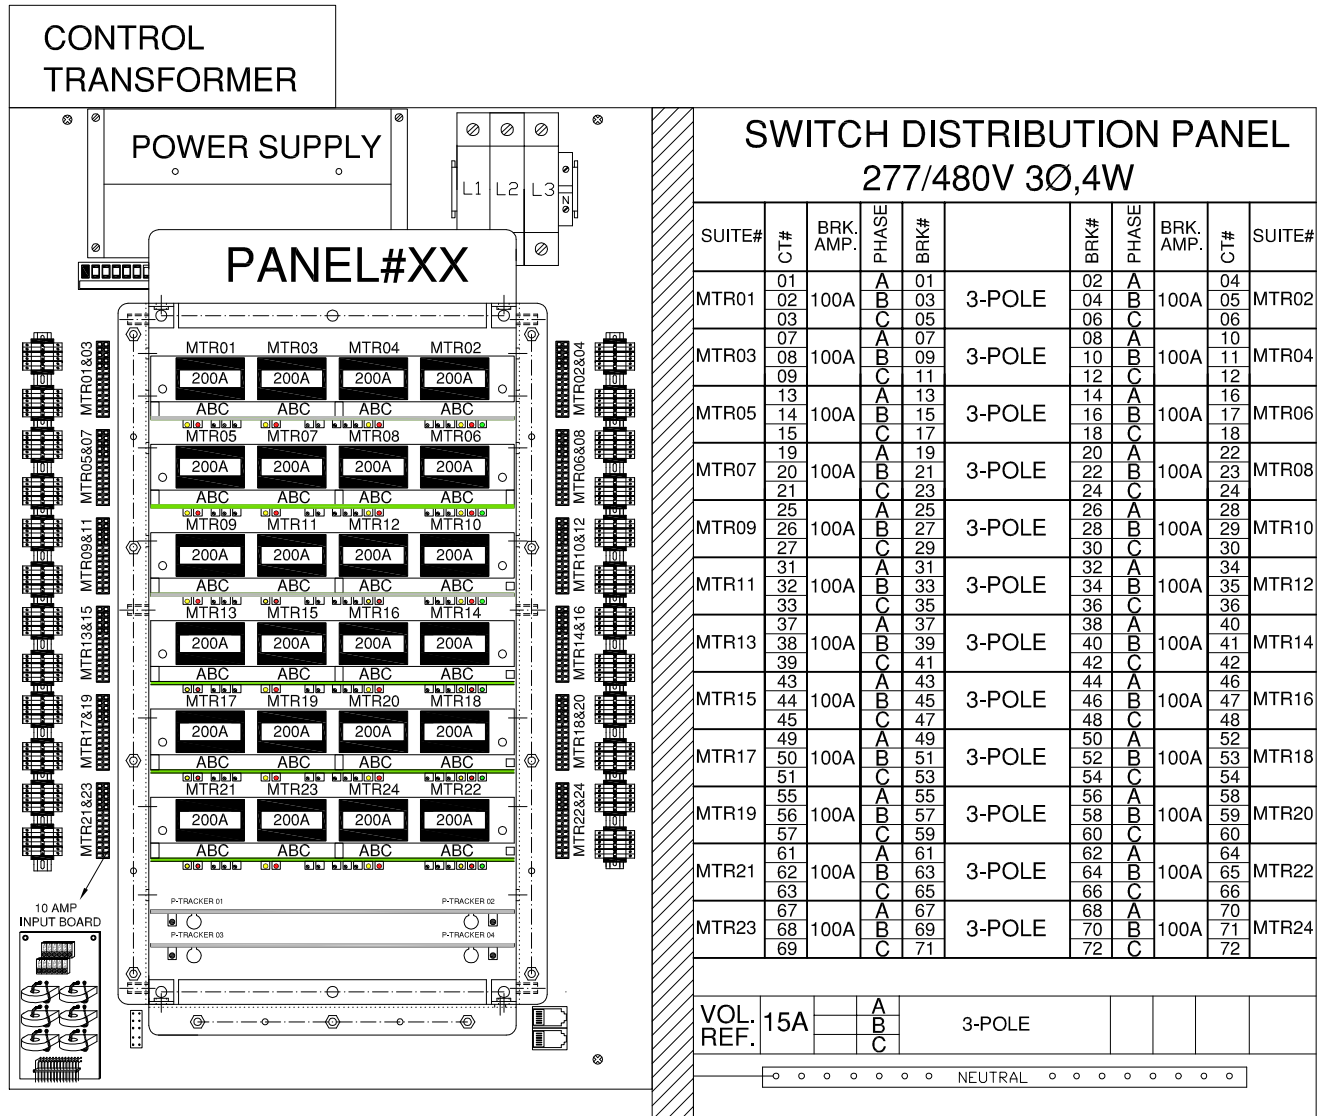

WARNING: METERING PANEL HAS BEEN PHASED ACCORDINGLY. DO NOT CHANGE ASSIGNED DISTRIBUTION.

SDP AND EMP DESIGNATION

SUITE NO.	METER NO.	SUITE NO.	METER NO.
IS METERED BY →	METER#01	IS METERED BY →	METER#02
IS METERED BY →	METER#03	IS METERED BY →	METER#04
IS METERED BY →	METER#05	IS METERED BY →	METER#06
IS METERED BY →	METER#07	IS METERED BY →	METER#08
IS METERED BY →	METER#09	IS METERED BY →	METER#10
IS METERED BY →	METER#11	IS METERED BY →	METER#12
IS METERED BY →	METER#13	IS METERED BY →	METER#14
IS METERED BY →	METER#15	IS METERED BY →	METER#16
IS METERED BY →	METER#17	IS METERED BY →	METER#18
IS METERED BY →	METER#19	IS METERED BY →	METER#20
IS METERED BY →	METER#21	IS METERED BY →	METER#22
IS METERED BY →	METER#23	IS METERED BY →	METER#24

N.B.: PLEASE COMPLETE THE SHOP DRAWING WITH THE APPROPRIATE SUITE IDENTIFICATION.

SDP : Switch Distribution Panel EMP: Electronic Metering Panel