


M3-8 WITH 10AMP INPUT(TYPICAL)

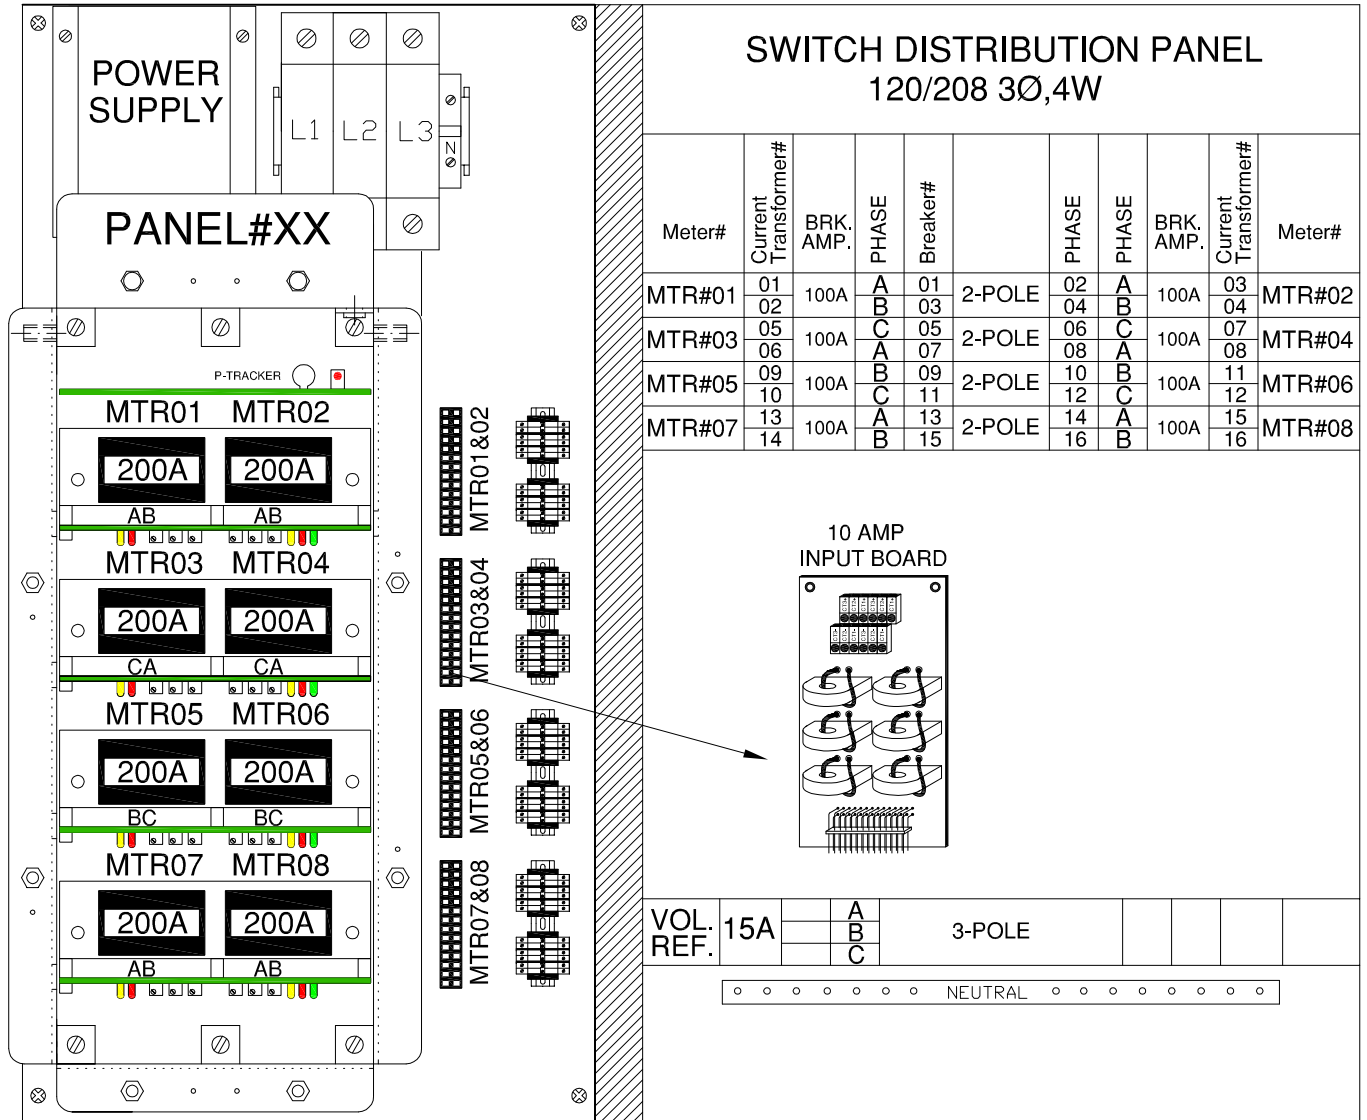

WARNING: METERING PANEL HAS BEEN PHASED ACCORDINGLY. DO NOT CHANGE ASSIGNED DISTRIBUTION.

SDP AND EMP DESIGNATION

SUITE NO.	METER NO.	SUITE NO.	METER NO.
	IS METERED BY → METER#01		IS METERED BY → METER#02
	IS METERED BY → METER#03		IS METERED BY → METER#04
	IS METERED BY → METER#05		IS METERED BY → METER#06
	IS METERED BY → METER#07		IS METERED BY → METER#08

N.B.: PLEASE COMPLETE THE SHOP DRAWING WITH THE APPROPRIATE SUITE IDENTIFICATION.

SDP : Switch Distribution Panel

EMP: Electronic Metering Panel

CT: Current Transformer