


M3-8 WITH 10AMP INPUT(TYPICAL)

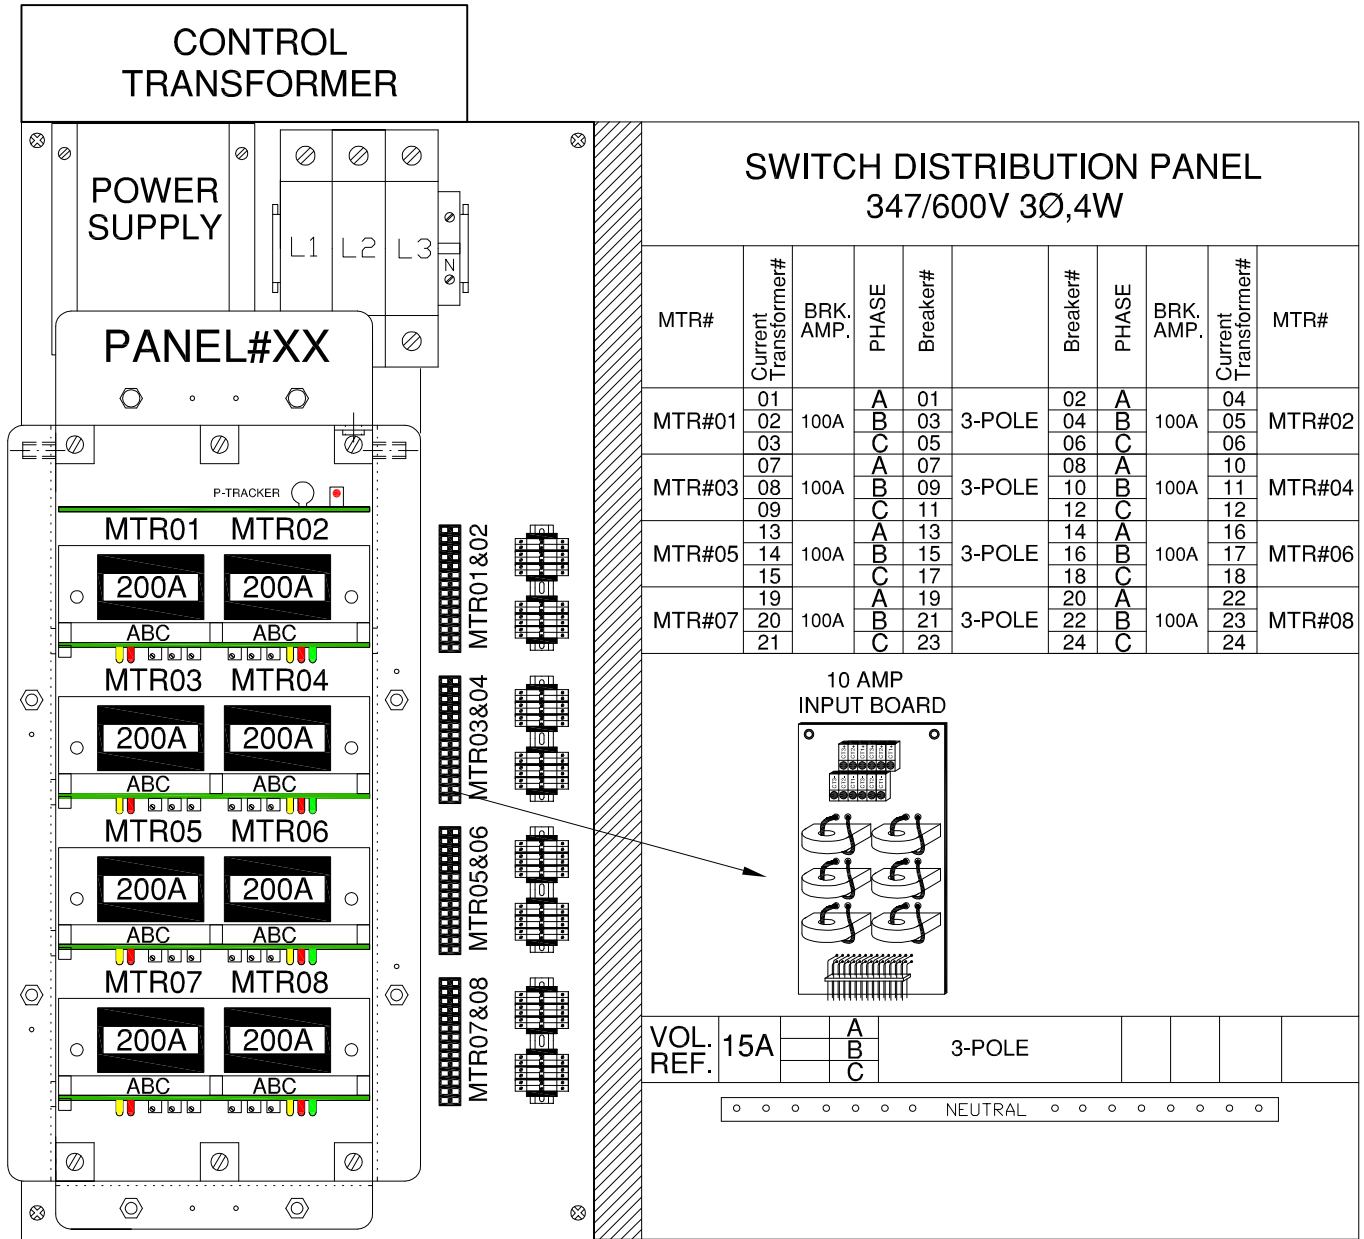

WARNING: METERING PANEL HAS BEEN PHASED ACCORDINGLY. DO NOT CHANGE ASSIGNED DISTRIBUTION.

SDP AND EMP DESIGNATION

SUITE NO.	METER NO.	SUITE NO.	METER NO.
IS METERED BY →	METER#01	IS METERED BY →	METER#02
IS METERED BY →	METER#03	IS METERED BY →	METER#04
IS METERED BY →	METER#05	IS METERED BY →	METER#06
IS METERED BY →	METER#07	IS METERED BY →	METER#08

N.B.: PLEASE COMPLETE THE SHOP DRAWING WITH THE APPROPRIATE SUITE IDENTIFICATION.

SDP : Switch Distribution Panel
CT: Current Transformer

EMP: Electronic Metering Panel