


TX-2005 METERING SYSTEM LAYOUT.

(TYPICAL)

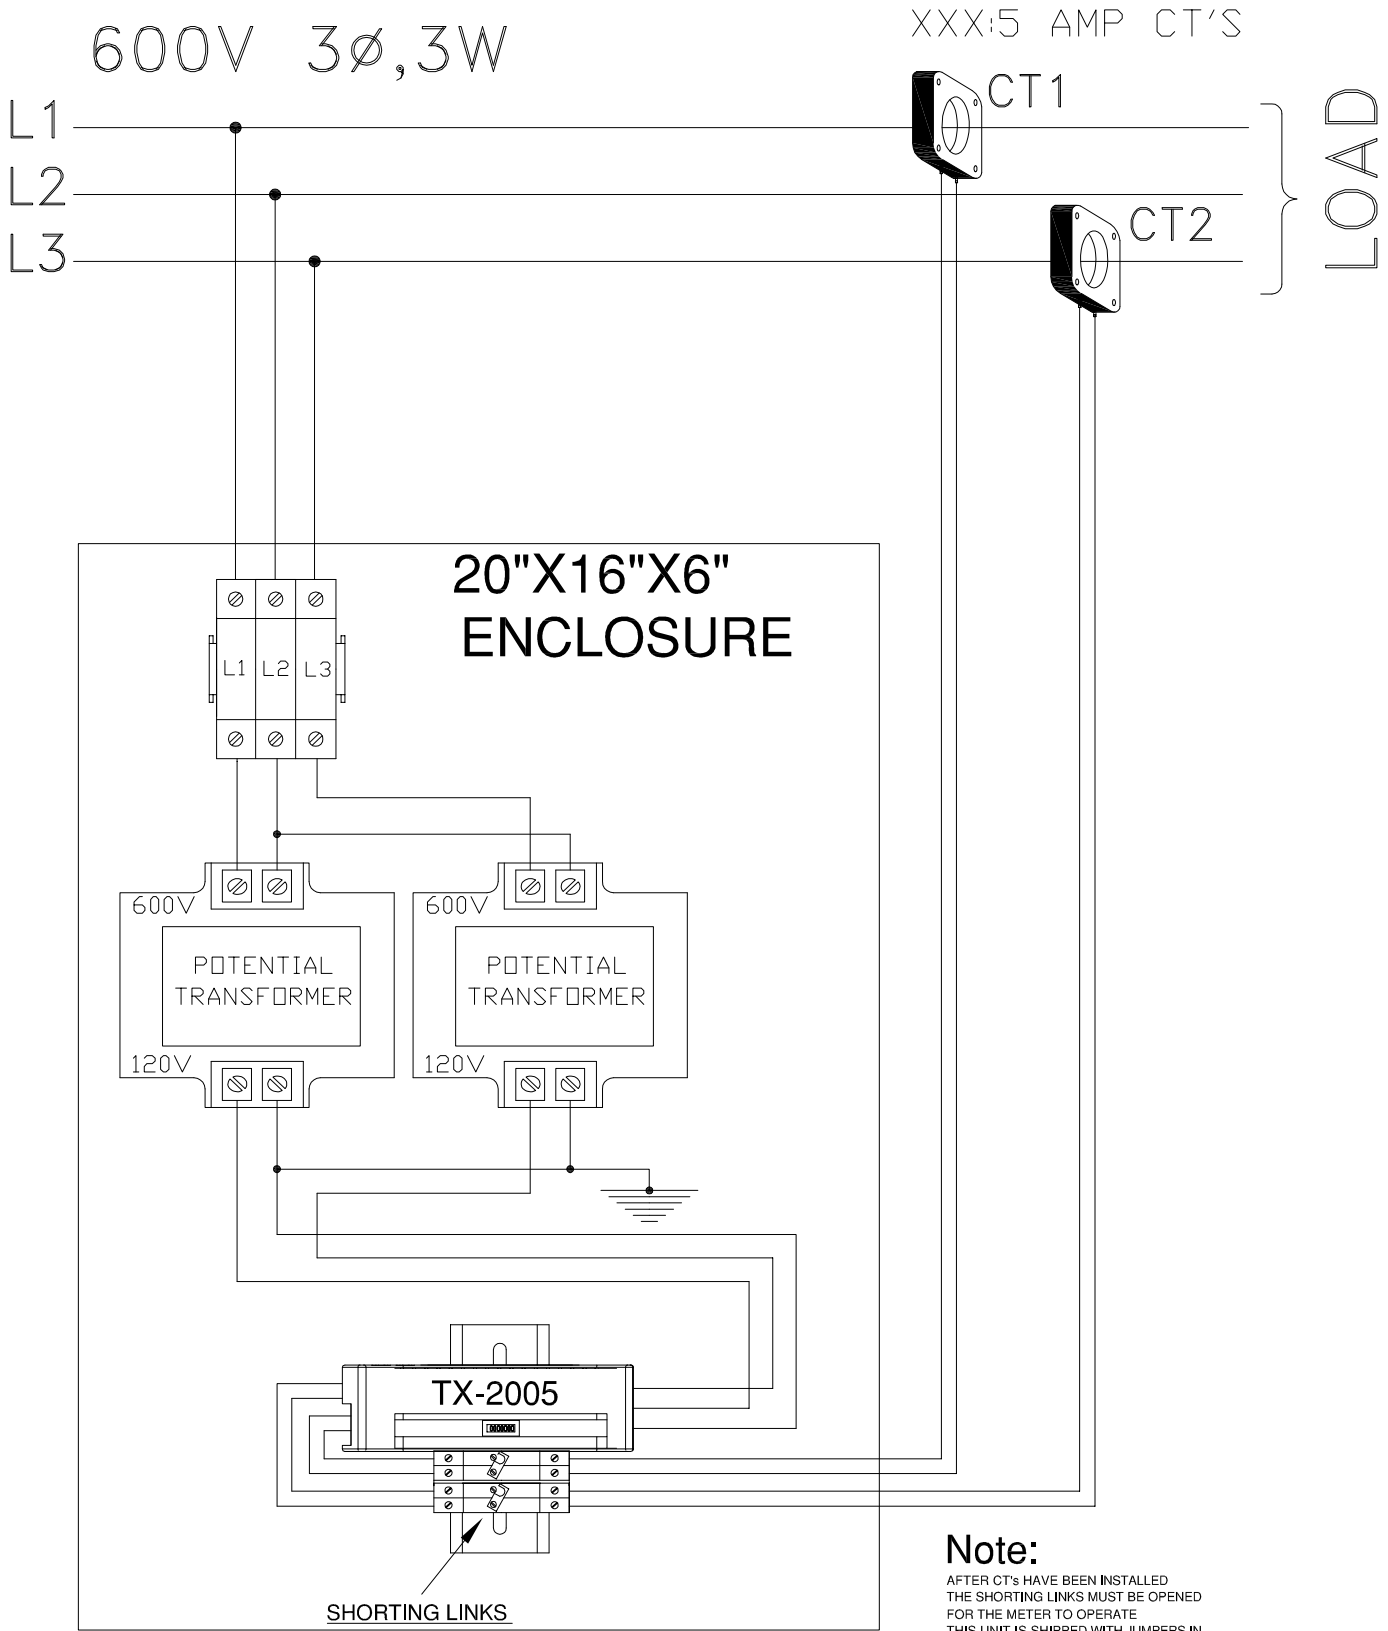

Note:
 AFTER CT'S HAVE BEEN INSTALLED
 THE SHORTING LINKS MUST BE OPENED
 FOR THE METER TO OPERATE
 THIS UNIT IS SHIPPED WITH JUMPERS IN
 CLOSED POSITION FOR SAFETY
 DURING INSTALLATION.

revision	date	Project Name:	Developer:	Engineer:	P.O.#	Contractor:	Date:	Project#:	Drawing#:	Drawn By:	Drawing:
A C	A B C									CRAIG HOUSE	TX1200102 (XXX:5A) (600V)