


RUN 2/C #18 FROM  
DOMESTIC COLD WATER  
MTR TO CONTROL PNL  
IN ELECTRICAL RM CONNECT  
TO TERM. BLOCK AS SHOWN.

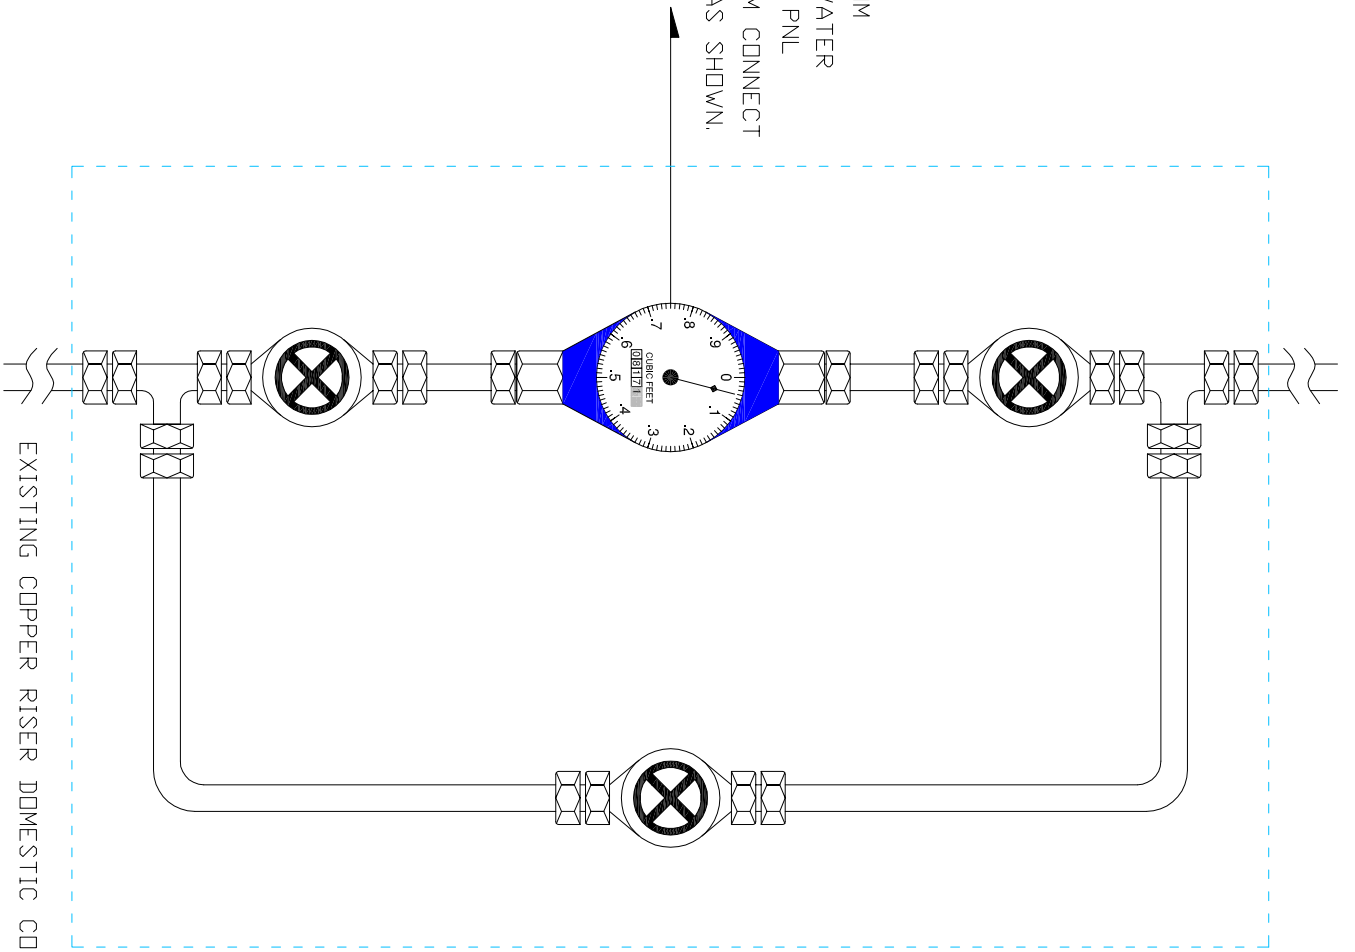

NOTE:  
CUT EXISTING WATER RISER  
RUN SAME EXISTING PIPE HORIZONTAL  
TO ALLOW 10 DIAMETERS AHEAD  
AND 5 DIAMETERS BEHIND  
NEW WATER METER.(STRAIGHT RUN)  
RECONNECT PIPE TO RISER  
PROVIDE BYPASS WITH FULL  
PORT BALL VALVE FOR FUTURE  
MAINTAINANCE. REINSULATE PIPES  
TO ORIGINAL CONDITION.

revision	date
A	1
B	2
C	3

Project Name:  
4Winds Drive

Engineer:

Distributor:

Rev. No./Date:

Contractor:

Drawn By:  
HOSEIN PAKBIN

Date:  
JULY 21, 2003

P.O.#

Drawing Number:

Project Number:

Drawing:  
WATER METER